




ELBASAN
Peqin
Librazhd
Belsh
Cërrik
Gramsh


UKR Elbasan

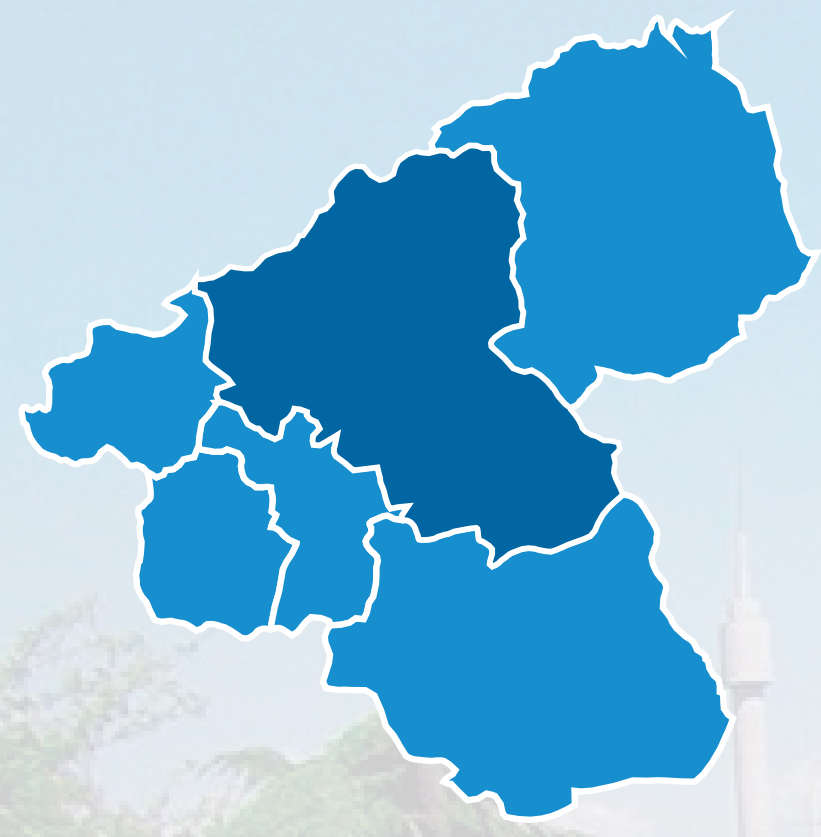

WPIP / MIP V – Masat e Investimit

- Mbi **42.5 km tubacione** do të zëvendësohen dhe do të instalohen rreth **3000 lidhje të reja abonentësh familjar**
- Instalimi i rreth **10.000 ujëmatës** të rinj në Elbasan
- **Rezervuari i ri në Krastën e Madhe**
- Rehabilitimi i plotë i rezervuarëve ekzistues Krastë e Madhe dhe Krasta e Vogël
- **Përmirësimi i sistemit DMA** për të përmirësuar kontrollin e rrjetit dhe për të reduktuar humbjet
- **Implementimi i sistemit SCADA** për monitorimin dhe kontrollin lokal dhe qendror të rezervuarëve, puseve dhe rrjeteve të shpërndarjes së ujit.
- Ndërtimi i **3.4 km për rrjetin e ujërave të zeza** për mbrojtjen e puseve në Mengel dhe Frigoriferi

Ndikimi kryesor: përmirësimi i furnizit me ujë - sistem i ri i kontrollit - puse të sigurta

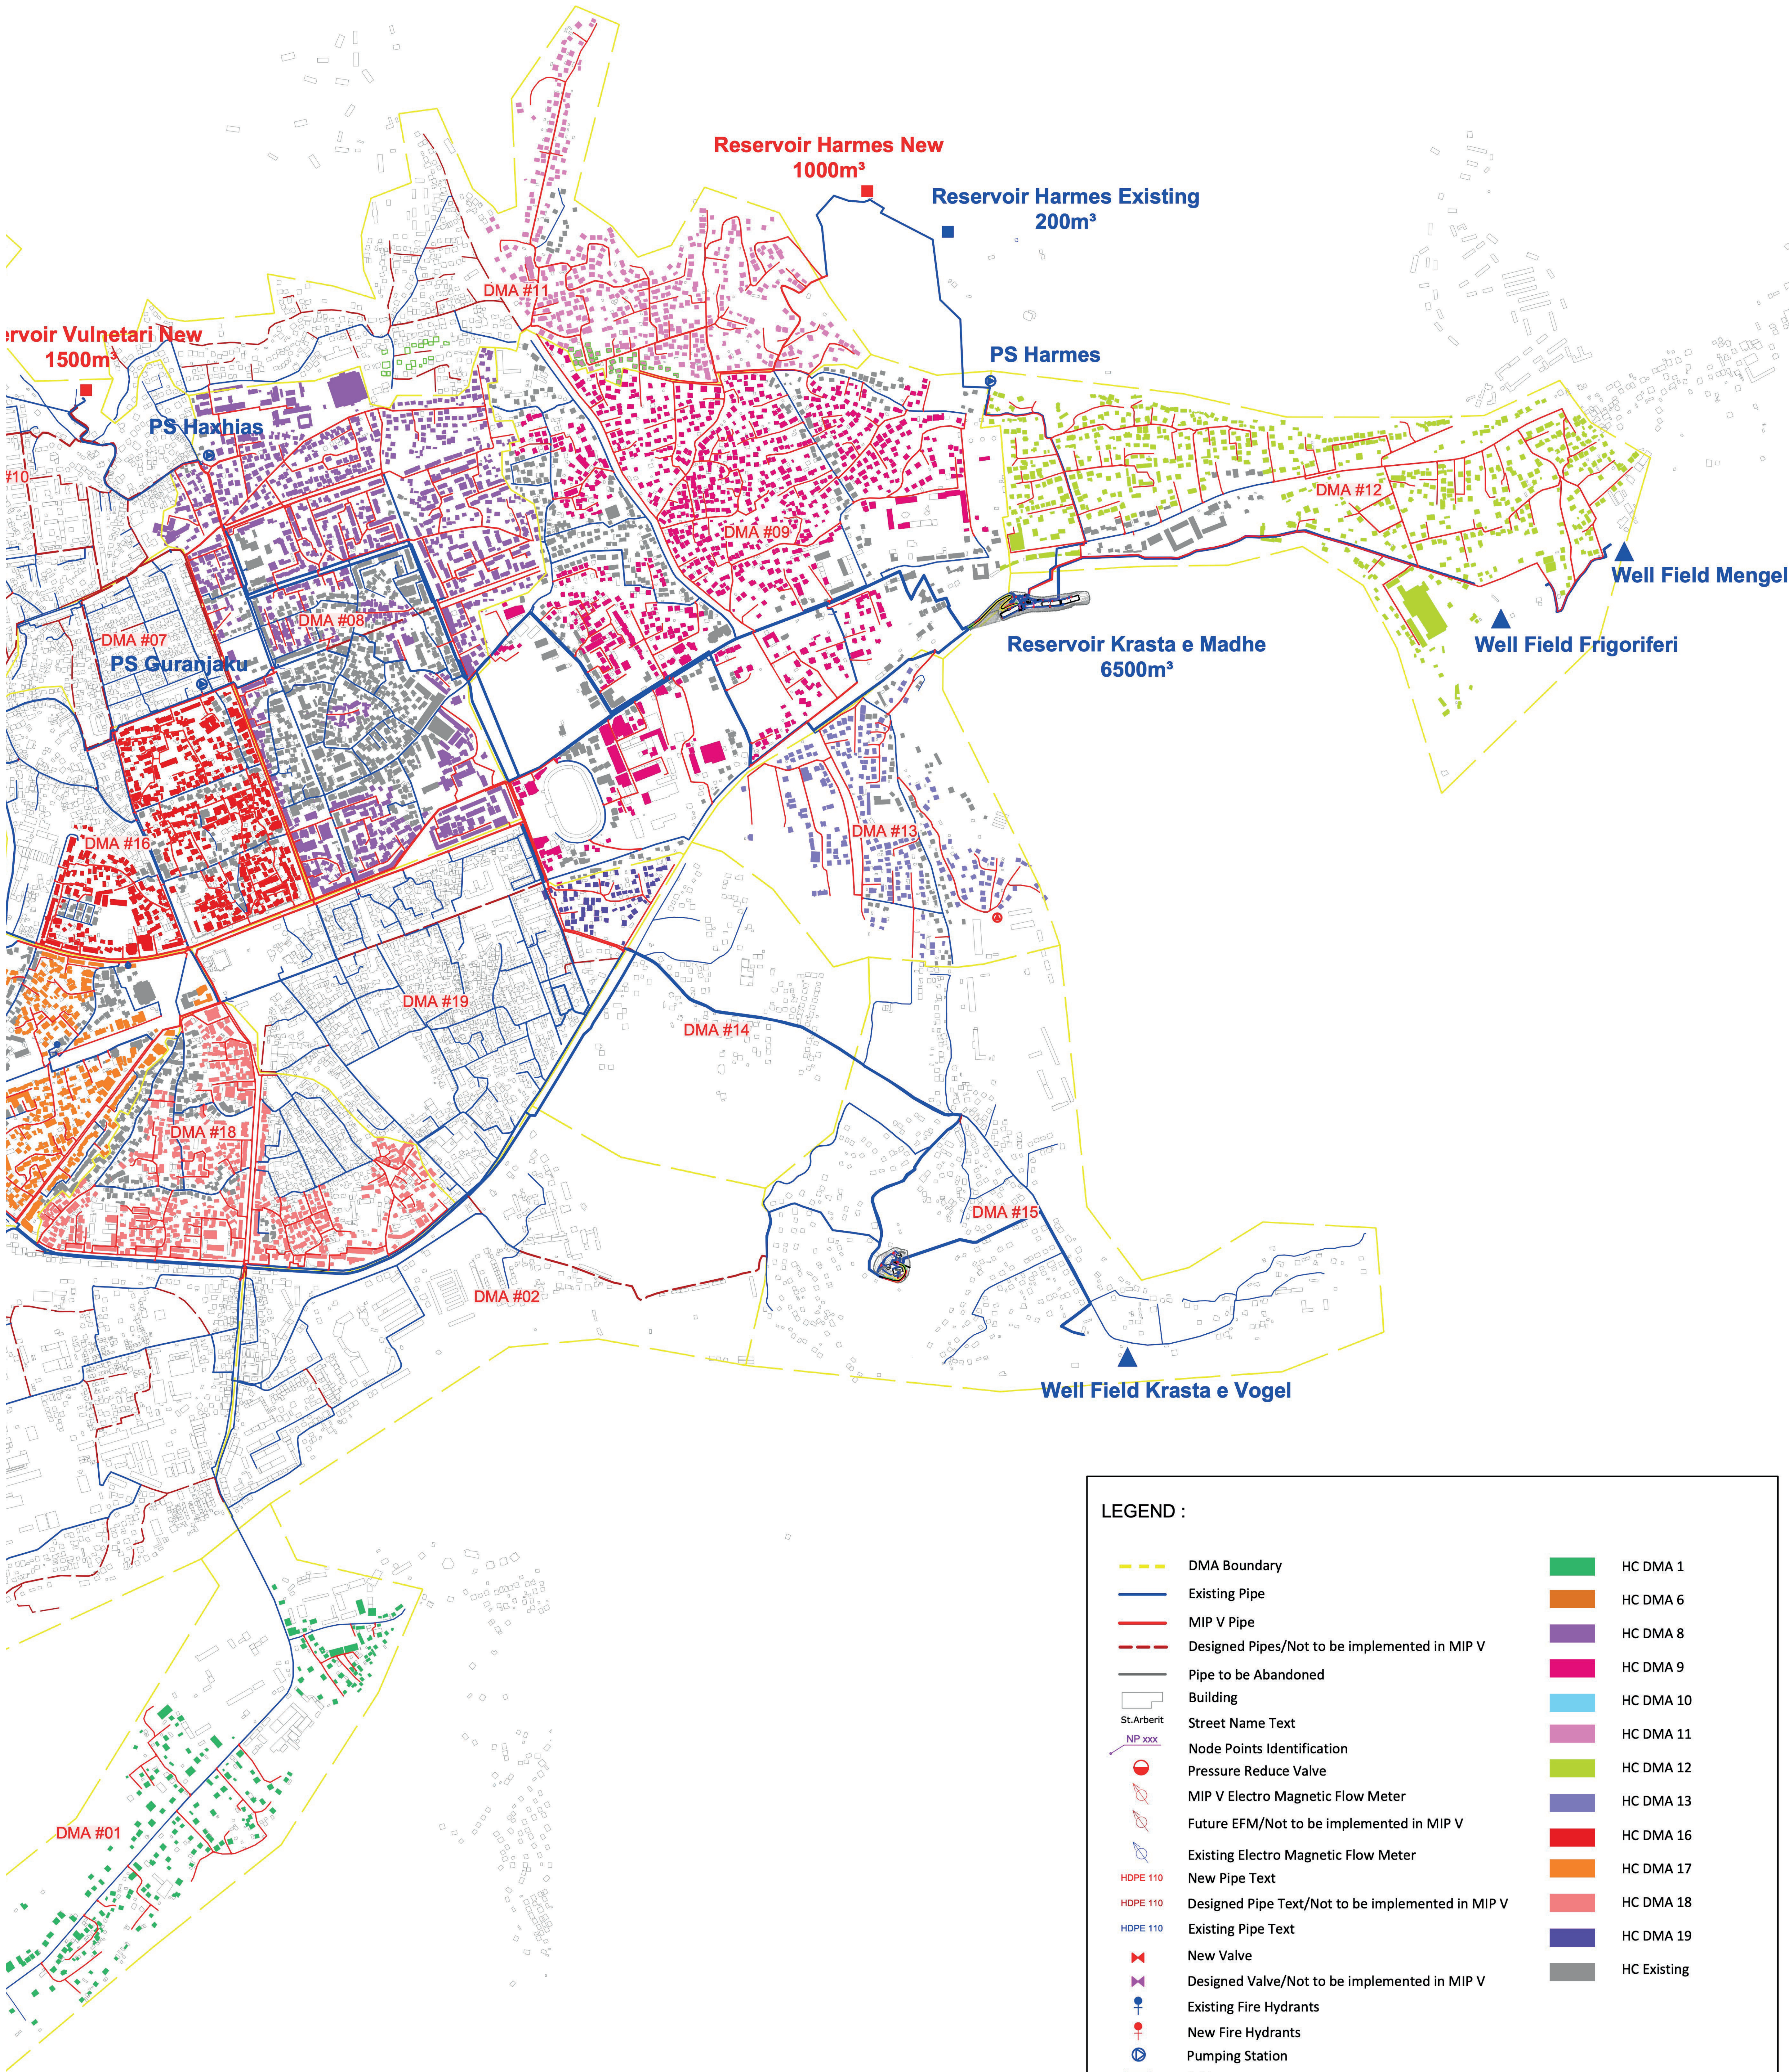

LEGEND :

- | | | | |
|---|---|---|-------------|
|  | DMA Boundary |  | HC DMA 1 |
|  | Existing Pipe |  | HC DMA 6 |
|  | MIP V Pipe |  | HC DMA 8 |
|  | Designed Pipes/Not to be implemented in MIP V |  | HC DMA 9 |
|  | Pipe to be Abandoned |  | HC DMA 10 |
|  | Building |  | HC DMA 11 |
|  | Street Name Text |  | HC DMA 12 |
|  | Node Points Identification |  | HC DMA 13 |
|  | Pressure Reduce Valve |  | HC DMA 16 |
|  | MIP V Electro Magnetic Flow Meter |  | HC DMA 17 |
|  | Future EFM/Not to be implemented in MIP V |  | HC DMA 18 |
|  | Existing Electro Magnetic Flow Meter |  | HC DMA 19 |
|  | New Pipe Text |  | HC Existing |
|  | Designed Pipe Text/Not to be implemented in MIP V | | |
|  | Existing Pipe Text | | |
|  | New Valve | | |
|  | Designed Valve/Not to be implemented in MIP V | | |
|  | Existing Fire Hydrants | | |
|  | New Fire Hydrants | | |
|  | Pumping Station | | |
|  | Bridges | | |
|  | Individual Pressure Reducer | | |